
UNIS "GINEX" d.d.

ELECTRIC DETONATOR ED-DD

EN ISO 9001:2015
EN ISO 14001:2015
EN ISO 45001:2018

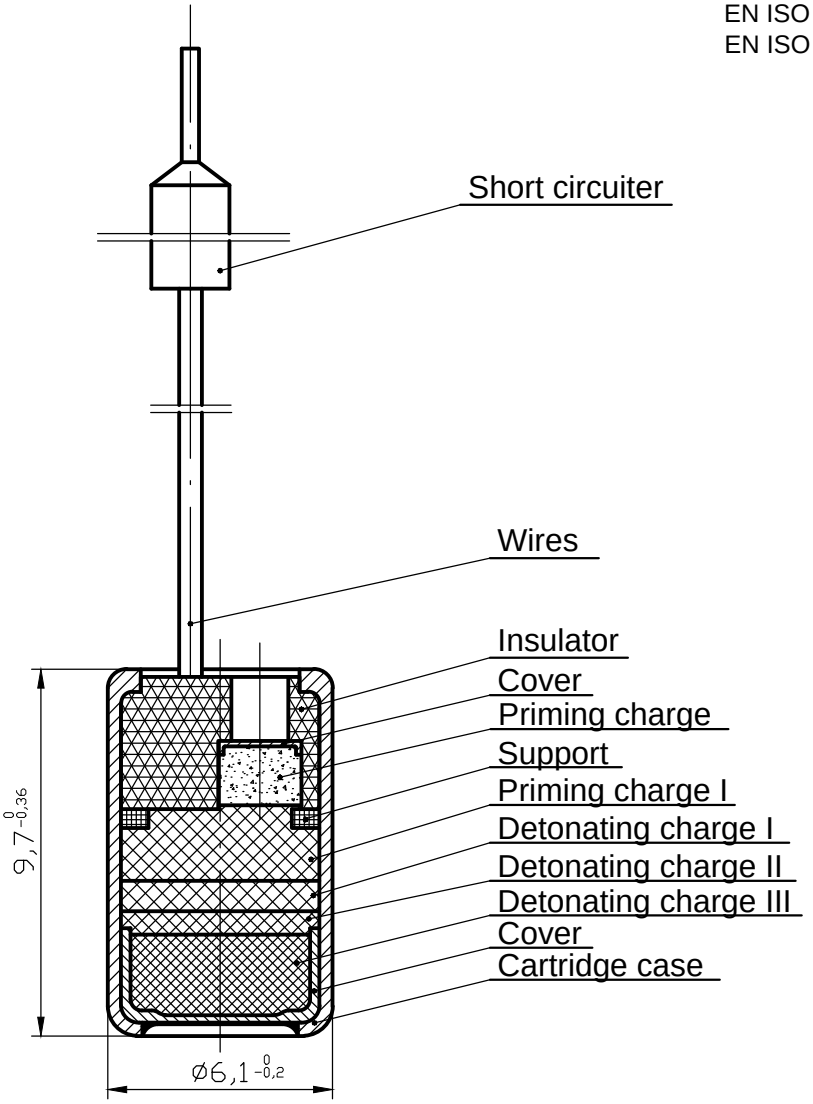

DESIGNED FOR USE IN:
Fuse 9E22M

QUALITY REQUIREMENTS:

1. Ohm resistance between the wires must be within 5 to 9Ω .
2. ED-DD must fail to function when direct current of 0,05 A is applied through the bridge for 5 minutes.
3. ED-DD must properly function when direct current of 1 A is applied through the bridge.
4. ED-DD must function at discharge of condenser of 0,2 μF±10% capacity charged to 70 V.
5. Function time of ED-DD must not exceed 100 μs when direct current of 1,2 A applied through the bridge od electric detonator.

PACKING:
15 Electric detonators ED-DD packed into a box
40 boxes (600 pcs.) packed into a tin container
2 tin containers (1200 pcs.) packed into a case

Tel: ++387 38 221 251, Fax: ++387 38 221 402, E-mail:ginexinfo@bih.net.ba
Visegradska bb, 73 000 Gorazde, Bosnia & Herzegovina